




Classified by
Underwriters Laboratories, Inc.
to UL 1479 and CAN/ULC-S115

System No. W-J-8047

WJ 8047

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 2 Hr	F Rating — 2 Hr
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating At Ambient — 5 CFM/sq ft (See Item 6B)	FH Rating — 2 Hr
L Rating At 400 F — 2 CFM/sq ft (See Item 6B)	FTH Rating — 0 Hr
	L Rating At Ambient — 5 CFM/sq ft (See Item 6B)
	L Rating At 400 F — 2 CFM/sq ft (See Item 6B)

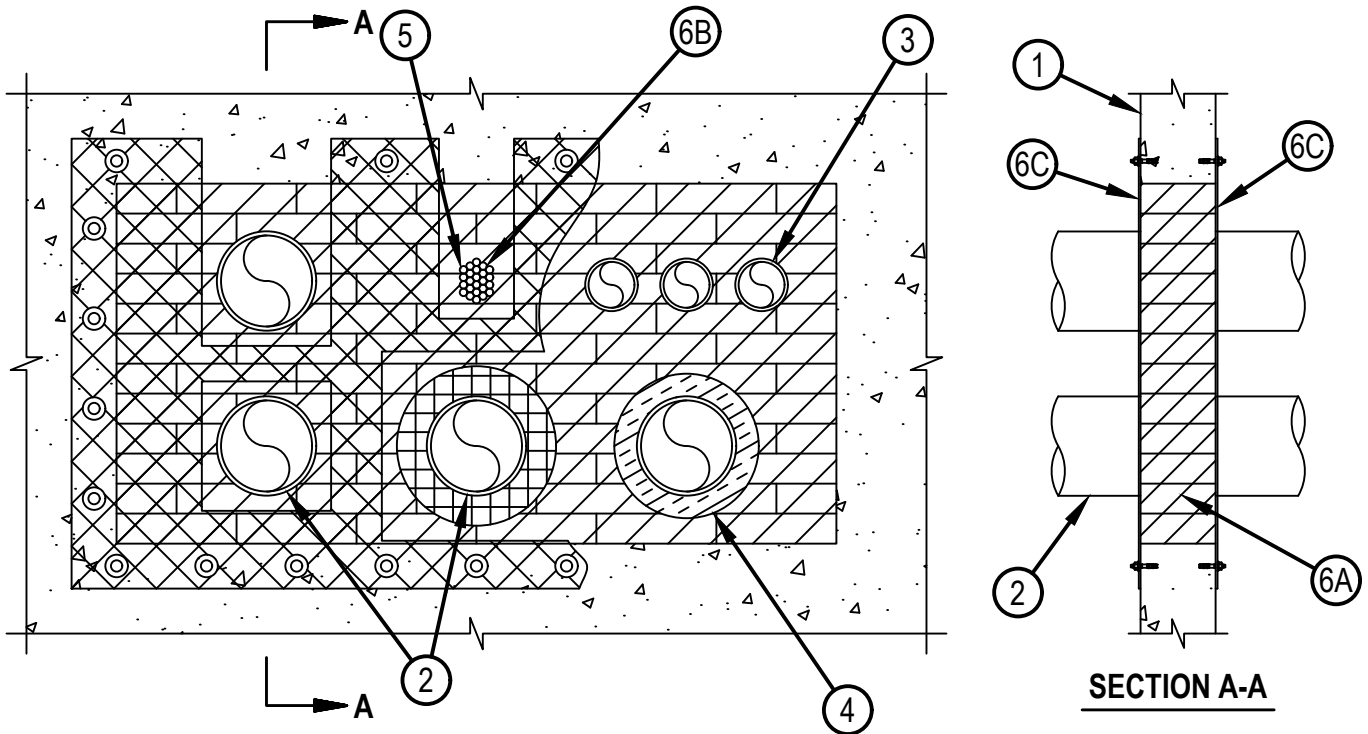

System tested with a pressure differential of 2.5 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.

1. Wall Assembly — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Maximum area of opening 1152 in² (7432 cm²) with maximum dimension of 48 in. (1219 mm).
2. Metallic Penetrants — One or more metal pipes, conduits or tubing may be installed within the through opening. The space between pipes, conduits or tubing shall be min 1 in. (25 mm) to max 26 in. (660 mm). The space between pipes, conduits or tubing and periphery of opening shall be min 0 in. (point contact) to max 26 in. (660 mm). Pipe, conduit or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - A. Steel Pipe — Nom 6 in. (152 mm) diam (or smaller) Schedule 5 (or heavier) steel pipe.
 - B. Iron Pipe — Nom 6 in. (152 mm) diam (or smaller) cast or ductile iron pipe.
 - C. Conduit — Nom 6 in. (152 mm) diam (or smaller) rigid steel conduit, nom 4 in. (102 mm) diam (or smaller) electrical metallic tubing (EMT) or nom 1 in. (25 mm) diam (or smaller) flexible steel conduit.
 - D. Copper Pipe or Tube — Nom 4 in. (102 mm) diam (or smaller) Regular (or heavier) copper pipe or Type L (or heavier) copper tube.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
June 8, 2022

3. Non-Metallic Penetrants — One or more non-metallic penetrants may be installed within the through opening. Penetrants to be rigidly supported on both sides of wall assembly. The following types and sizes of non-metallic penetrants may be used:
- A. Polyvinyl Chloride (CPVC) Pipe — Max 2 in. (51 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply). The space between pipes or conduits shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). The space between pipes or conduits and periphery of opening shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm).
 - B. Rigid Nonmetallic Conduit (RNC)+ — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with the National Electrical Code (NFPA No. 70). The space between pipes or conduits shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). The space between pipes or conduits and periphery of opening shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm).
 - C. Optical Fiber/Communication Cable Raceways+ — Nom 2 in. (51 mm) diam (or smaller) optical fiber raceway, formed from polyvinyl chloride (PVC). Raceway to be installed in accordance with the National Electrical Code (NFPA No. 70). The annular space between the raceway and the periphery of the opening shall be minimum 2 in. (51 mm) to max 26 in. (660 mm). The minimum space between adjacent penetrants shall be 3-1/2 in. (89 mm).
- See Optical Fiber/Communication Cable Raceways (QAZM) category in the Electrical Construction Materials Directory for names of manufacturers.
4. Pipe Insulation — (Optional) — Pipe insulation may be installed on one or more of the metallic pipes or tubes (Items 2A, 2B and 2D). When pipe insulation is used, min space between insulated metallic penetrant and bare metallic pipes, conduits and tubing shall be min 1-1/2 in. (38 mm) and min space to periphery of opening shall be 1 in. (25 mm). The following types of pipe insulations may be used:
- A. Pipe and Equipment Covering Materials* — Max 1-1/2 in. (38 mm) thick hollow cylindrical heavy density (min 3.5 pcf or 56 kg/m³ glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product.
- See Pipe and Equipment Covering Materials (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.
- B. Pipe and Equipment Covering Materials* — Max 1-1/2 or 2 in. (38 or 51 mm) thick hollow cylindrical calcium silicate, min 10 or 14 pcf (160 or 224 kg/m³ respectively, units sized to the outside diam of the pipe or tube. Pipe insulation secured with stainless steel bands or with min No. 18 AWG stainless steel wire spaced max 6 in. (152 mm) from each face of wall and spaced max 12 in. (305 mm) OC.
 - C. Tube Insulation-Plastics+++ — Max 3/4 in. (19 mm) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the foam of tubing. This pipe insulation may be installed on metallic pipes or tubes (Items 2A, 2B and 2D) not exceeding nom 2 in. (51 mm) diam. See Plastics+++ (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.
5. Cables — (Optional) — Maximum eight 3 in. (76 mm) diam (or smaller) tight bundle of cables installed within the opening and rigidly supported on both surfaces of wall. The space between the cables and periphery of the opening shall be min 1-3/16 in. (30 mm) to 26 in. (660 mm). The space between cables bundles and/or other penetrants shall be min 1-1/2 in. (38 mm) to max 26 in. (660 mm). Any combination of the following types and sizes of cables may be used:
- A. 1/C 750 kcmil (or smaller) power cable with EPR polyvinyl chloride (PVC) insulation and jacket.
 - B. 300 pair - No. 24 AWG telephone cable with PVC insulation and jacket.
 - C. 24 fiber optic cable with PVC outer and subunit jacket.
 - D. 3/C No. 12 AWG copper conductor Metal Clad+ cable with PVC insulation.
 - E. 7/C No. 12 AWG with polyvinyl chloride (PVC) insulation and jacket.
 - F. Type R GU/59 coaxial cable with PVC outer jacket.
 - G. 4 pair 22 AWG Cat 5 or Cat 6 data cable.



6. Firestop System — The firestop system shall consist of the following:

A. Fill, Void or Cavity Material* — Fire Blocks — Fire block installed with 5 in. (127 mm) dimension projecting through and centered in opening. Blocks firmly packed to completely fill the area of the opening. In concrete block walls, fire block to be installed to full thickness of wall unless wall is solid filled. Either one or a combination of the block types specified below may be used.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-BL Firestop Block

B. Fill, Void or Cavity Material* — Fill material to be forced into interstices of cables, and in any voids/openings between blocks, around penetrants, and between blocks and periphery of opening to the maximum extent possible on both surfaces of wall.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE MAX Intumescent Sealant, CP618 Firestop Putty Stick, CP 660 Firestop Foam or CP 620 Fire Foam, Note: CP 618, CP 620, and CP 660 not suitable for use with CPVC (Item 3A). (Note: L Ratings apply only when FS-ONE MAX Intumescent Sealant is used.)

C. Wire Mesh — When the annular space exceeds 4 in. (102 mm) between penetrants and/or to the periphery of the opening, max 2 by 2 in. (51 by 51 mm) wire fencing shall be used to keep the blocks in place. The wire fencing shall be fabricated from min No. 16 SWG (0.060 in. or 1.5 mm) galv steel wire. The wire is cut to fit the contour of the penetrating item with a min 3 in. (76 mm) lap beyond the periphery of the opening. Wire fencing secured to both surfaces of wall by means of 1/4 in. diam by 1 in. long steel concrete anchors and 1/4 in. by 1-1/2 in. diam fender washers spaced max 8 in. (203 mm) OC. The joints within the wire mesh shall overlap a min of 2 in. (51 mm) and be secured together by means of No. 16 AWG steel wire spaced 8 in. (203 mm) OC.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

+ Bearing the UL Listing Mark



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.
June 8, 2022